

Process automation

Programmable Logic Controllers (PLCs)

- the hardware -

BS UNI studies, Fall semester 2024/2025

Octavian M. Machidon
octavian.machidon@fri.uni-lj.si

Outline


- Evolution of PLCs
- PLC architecture
- Types of PLCs
- Signal processing
- Program execution cycle
- Comparison of PLC systems
- Important PLC manufacturers
- Memory structure in PLCs

Evolution over time


- Early Systems
 - Control: Fixed wired logic (relays)
 - Regulation: Pneumatic, hydraulic, electromechanical analog systems
- Need for New Devices
 - Rapid development of control systems
 - Robust design (resistant to dirt, water, electromagnetic disturbances)
 - Reliability and ease of use
 - Reprogrammability
 - Integration of binary and analog worlds
- Functionalities
 - Logical operations
 - Control and increasingly regulation
 - Data collection for monitoring purposes
 - Interface with higher-level control systems



Architecture of a PLC

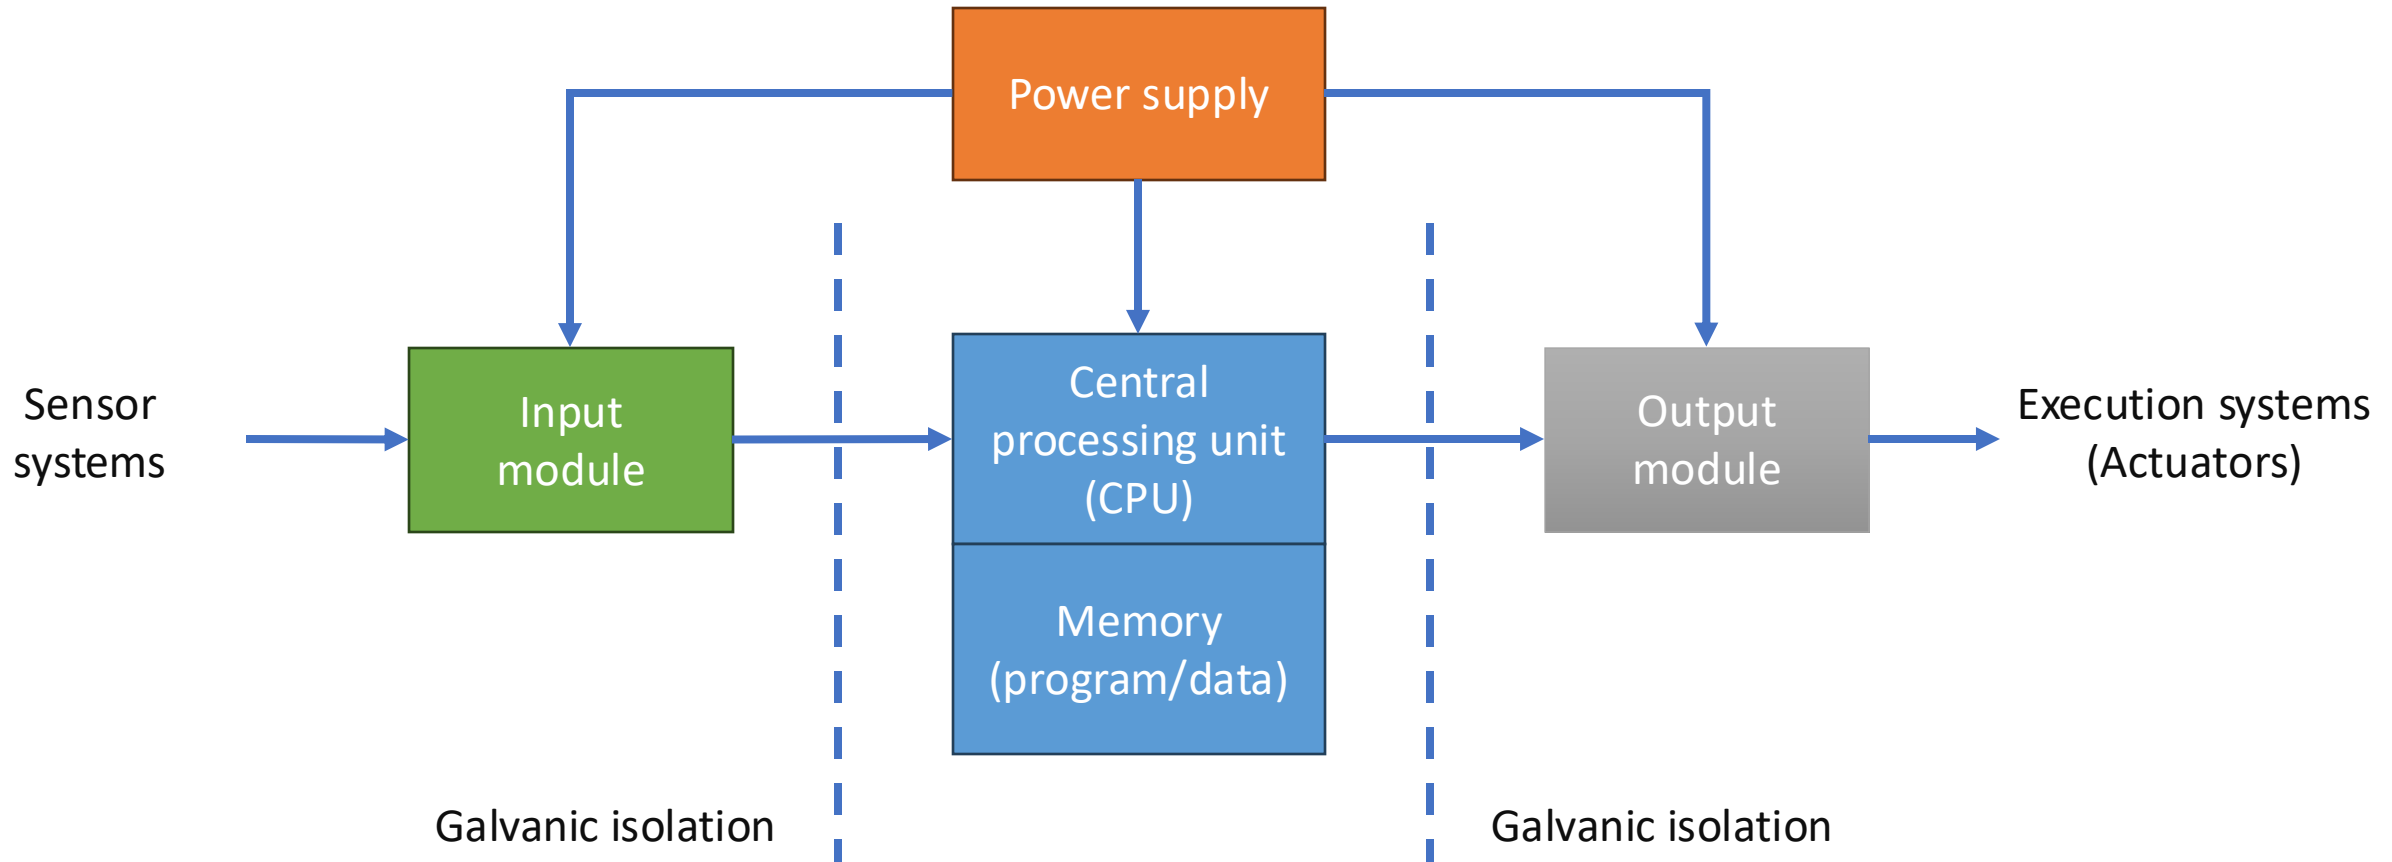

Architecture: input and output modules

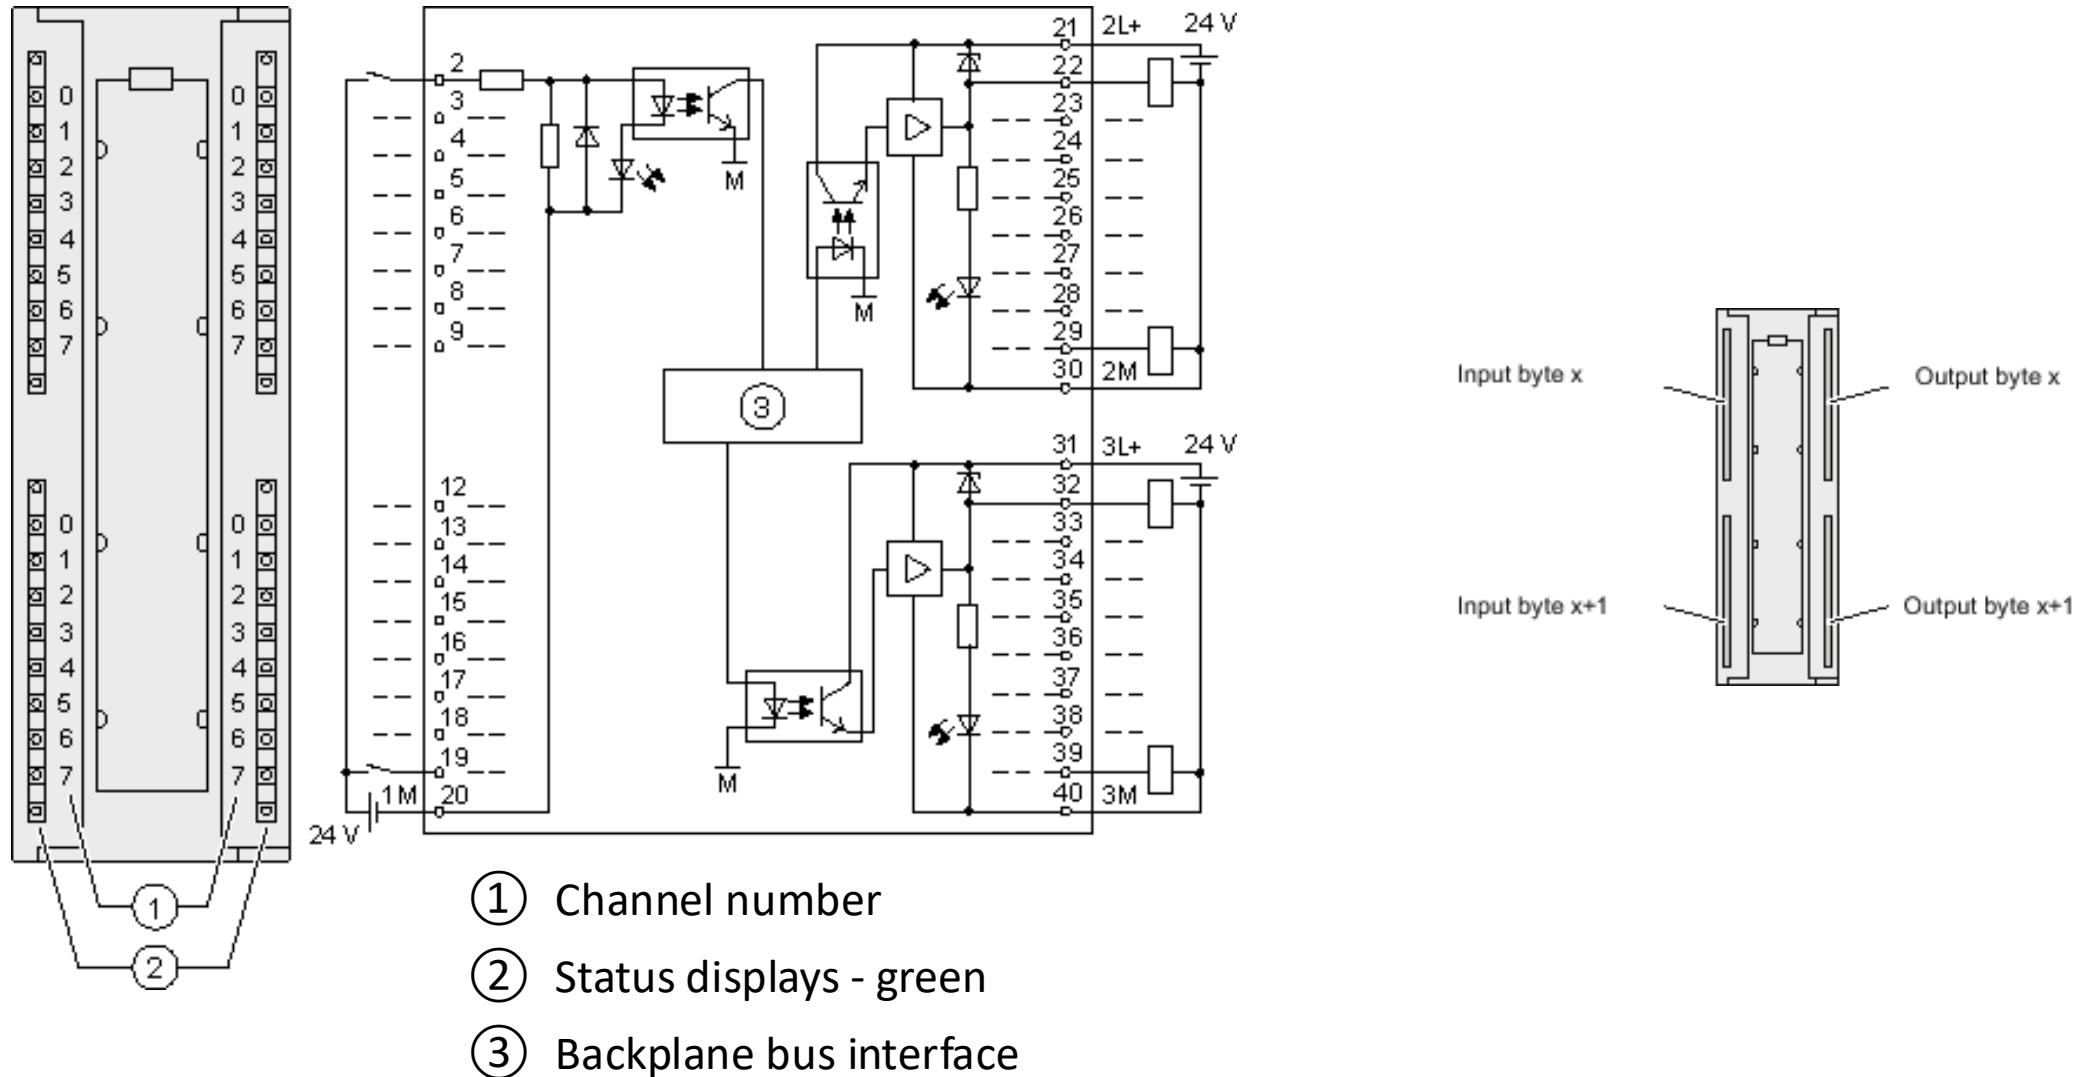


Architecture: input and output modules


Galvanic Isolation - Example: EL1859 Module

Galvanic isolation is made between the power current of channels (inputs/outputs) and the communication bus (E-bus).


There is no isolation between channels in this case.

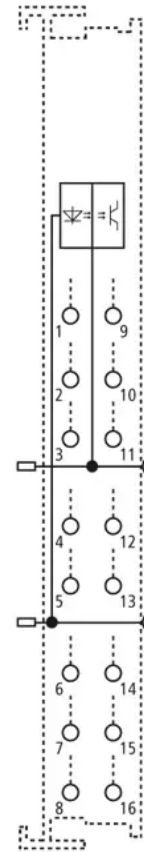

Detailed architecture

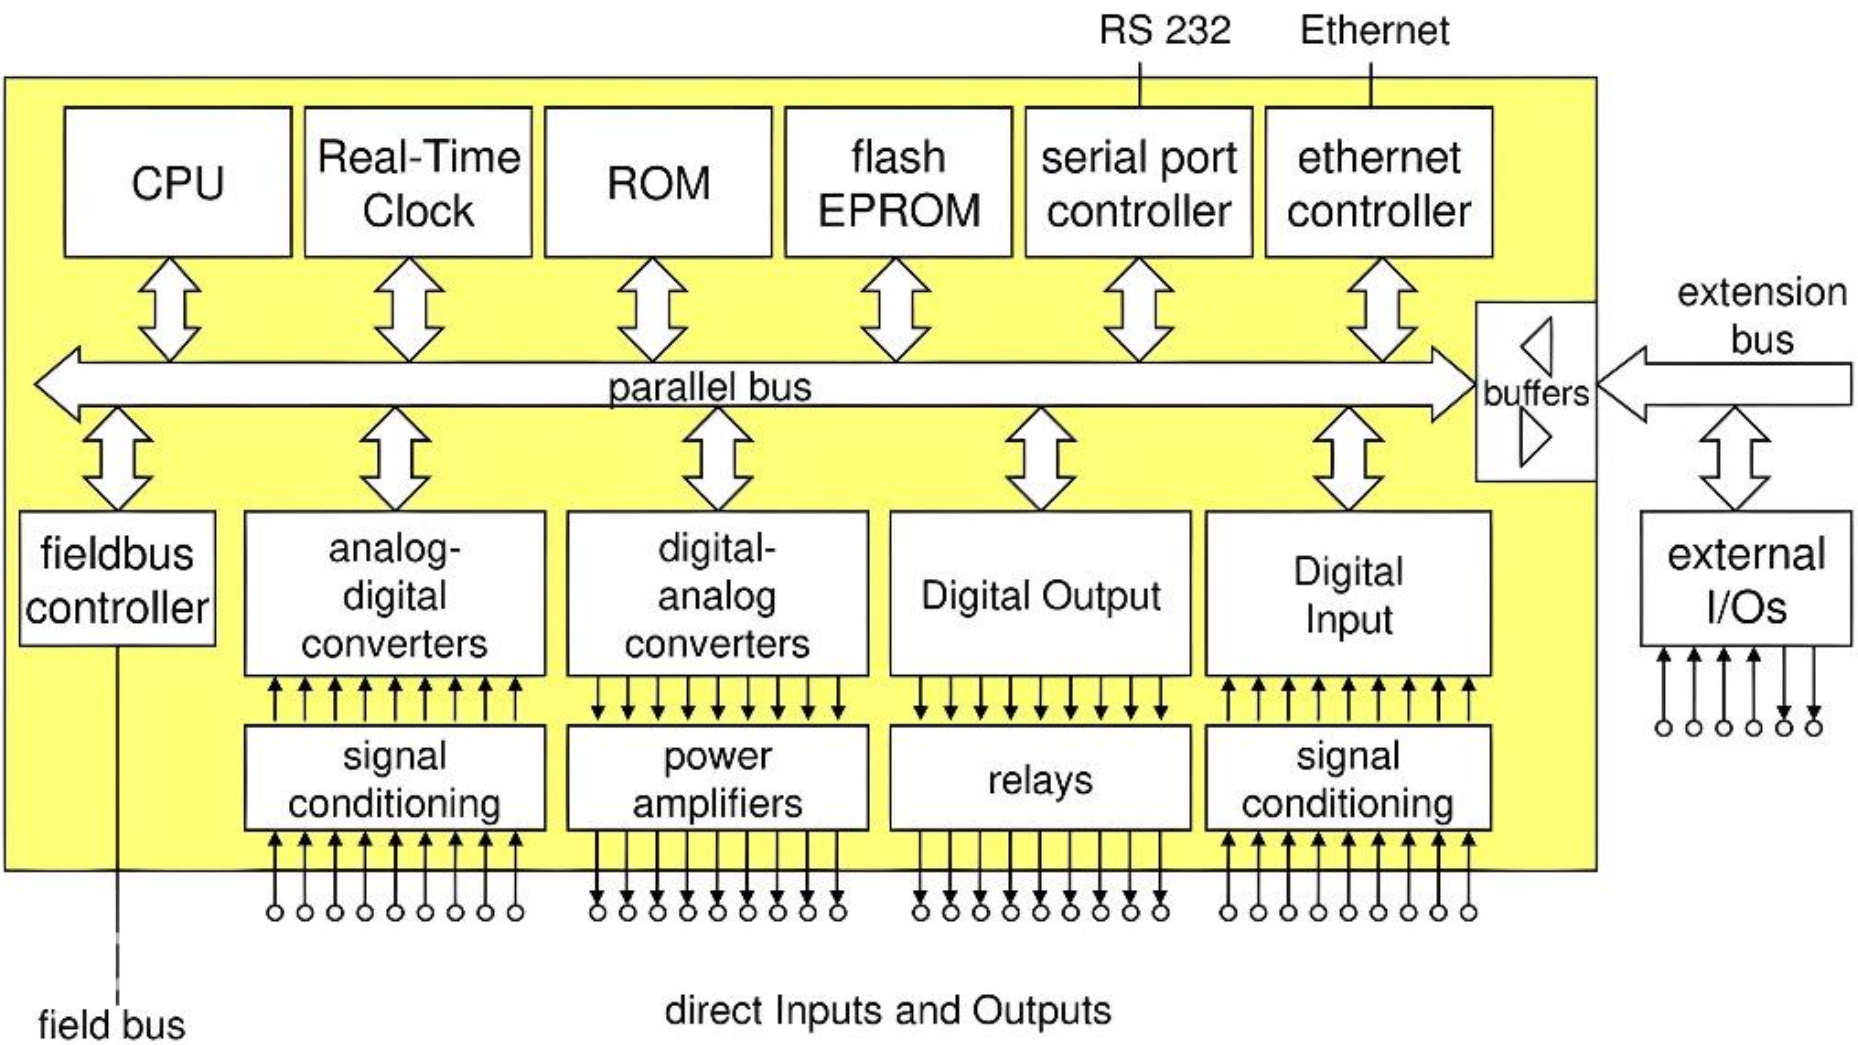

Signal Reception and Transmission

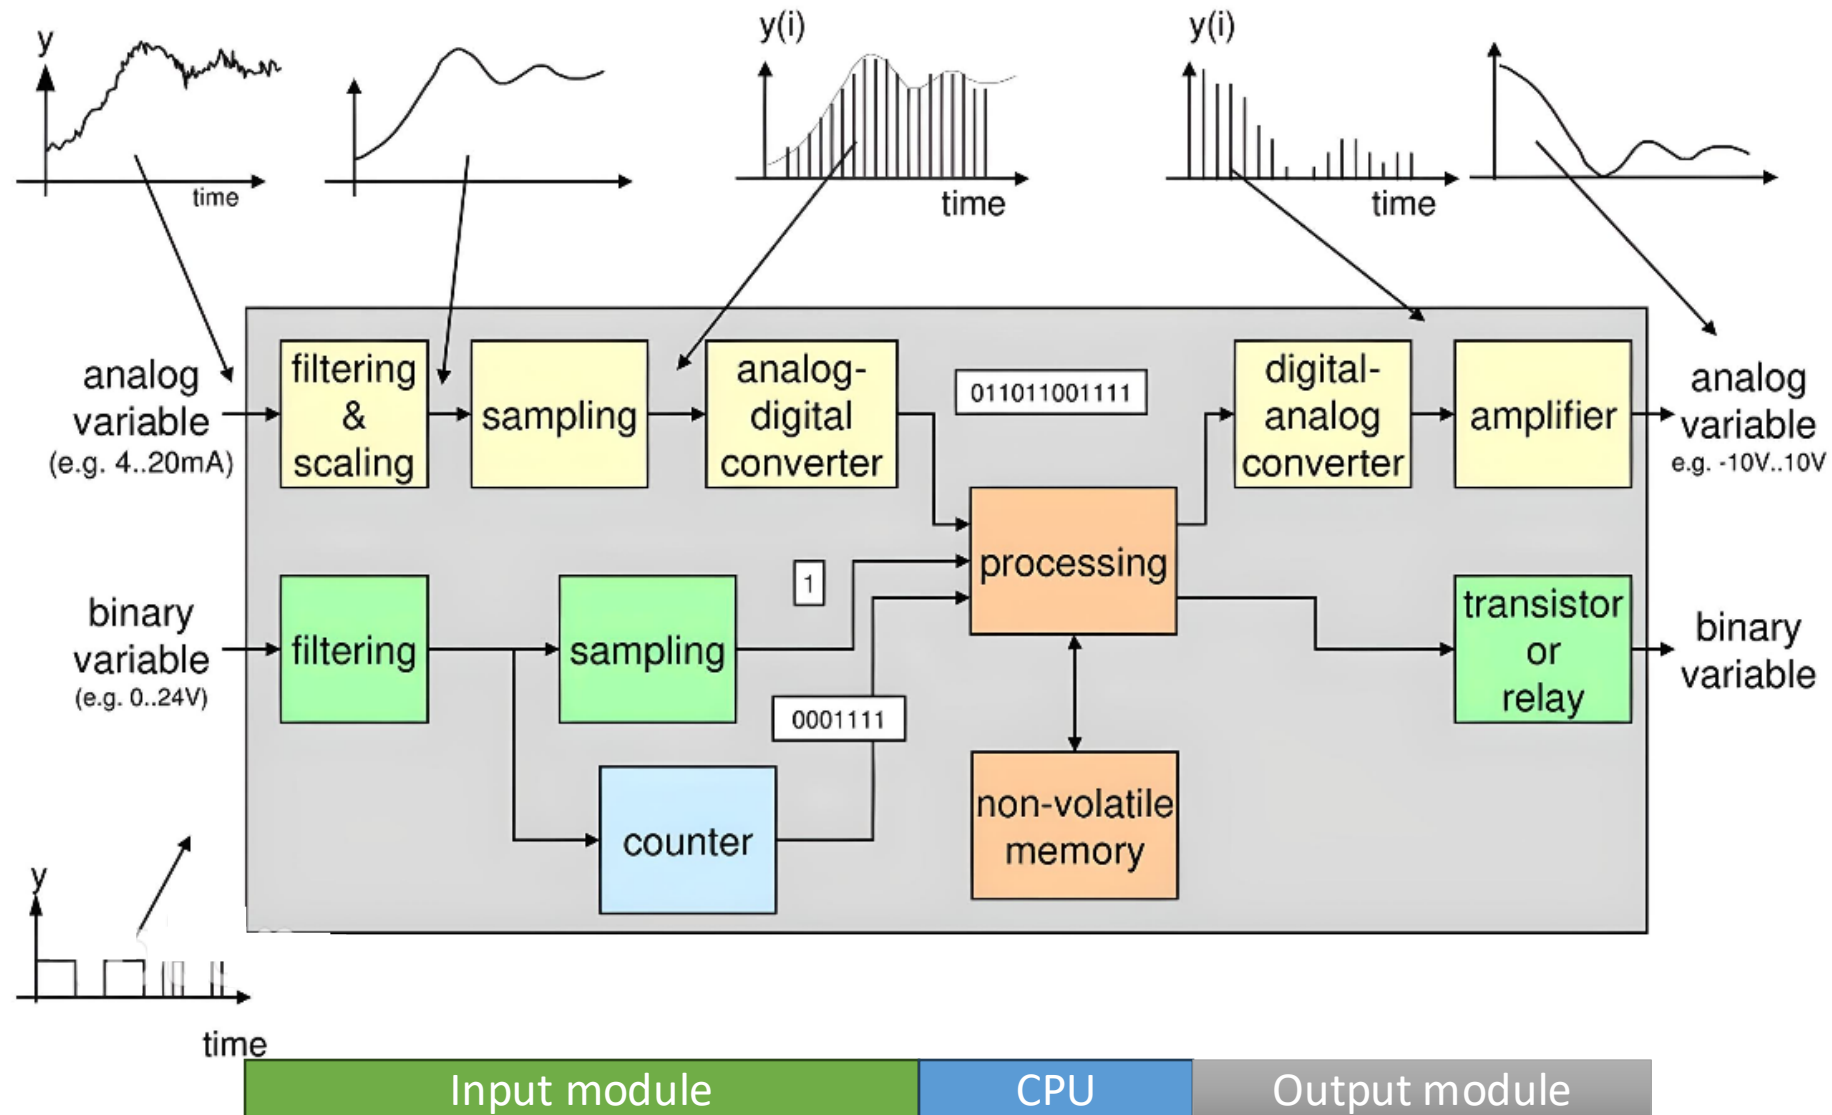

PLC types

Compact PLCs

- Monolithic design
- Fixed number of I/O
- I/O are usually binary
- Expansion possibility
- One microprocessor



Modular PLCs

- Wide selection of modules
- Communication between CPU and modules via a parallel bus
- Highly capable (can be multiprocessor systems)
- No human-machine interface (HMI)
- Mounted on a rail
- Large systems

Small Modular PLCs

- Medium to large systems
- No fans
- Cheaper than large modular PLCs



PLC types

Soft PLC

- Runs as a program on a personal computer
- PCI(e) card for communication bus
- Utilizes the resources of the personal computer



Industrial PCs

- Competitors to modular PLCs
- Do not have local I/O modules
- Limited modularity
- HMI interfaces available



Special Versions

- No fans
- Wide temperature range
- Resistance to vibrations
- Example: Locomotive



PLC Manufacturers


- **Europe**

- Siemens – SIMATIC (60% market share)
- Beckhoff
- ABB
- Schneider Electric
- WAGO
- Phoenix Contact
- Robotina – Cybro (Slovenia)

- **Worldwide**

- GE & Fanuc
- Honeywell
- Invensys (Foxboro)
- Rockwell (Allen-Bradley)
- Emerson (Fisher Control, Rosemount, Westinghouse)
- Hitachi, Toshiba, Fujitsu, Yokogawa

Compact vs. modular PLCs

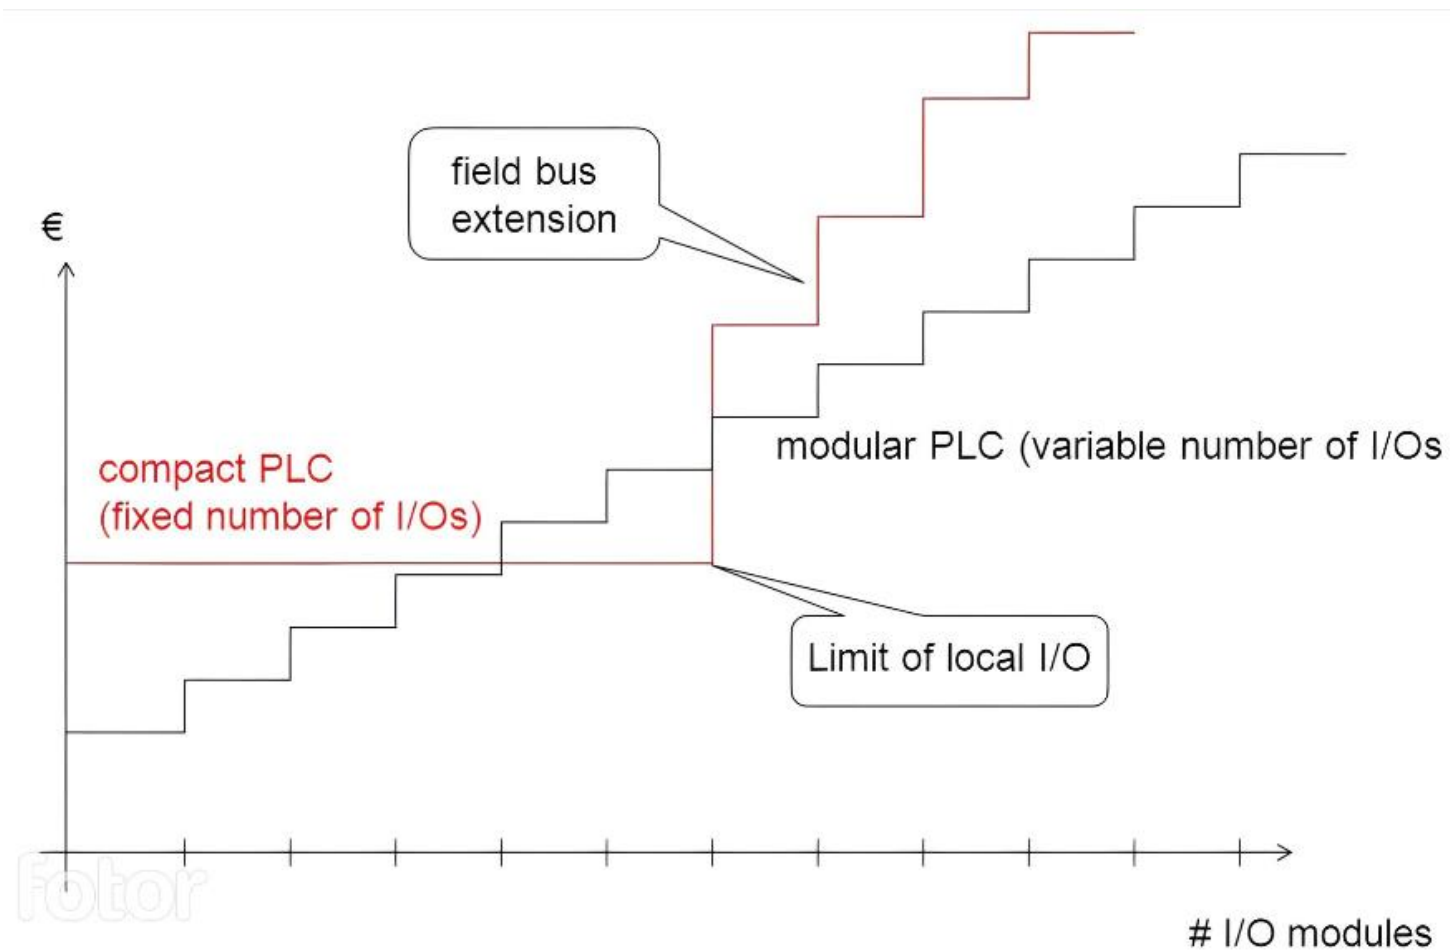


Comparison: PLC and Industrial PC

PLC	Industrial PC
Basic hardware and software: <ul style="list-style-type: none">- modular design- programming in relay logic (IEC 61131 standard)	More complex hardware and software: <ul style="list-style-type: none">- high-level programming languages
No standard user I/O devices	Screen, keyboard, mouse
Sequential execution of a single program (usually)	Executes multiple programs simultaneously
Designed for maintenance by electricians	Maintenance performed by computer scientist/programmer
Troubleshooting easy due to basic design, errors indicated visually	Error handling and debug handled by programmer

PLC program cycle

- Cycle time (scan time)
- Typically a few milliseconds (10 ms)
- Depends on:
 - Processor speed
 - Input reading method, program interpreter (LAD vs. ST)
 - Length and complexity (logic, arithmetic) of the program
- Operating System:
 - Ensures the correct execution of the program cycle
 - Manages memory

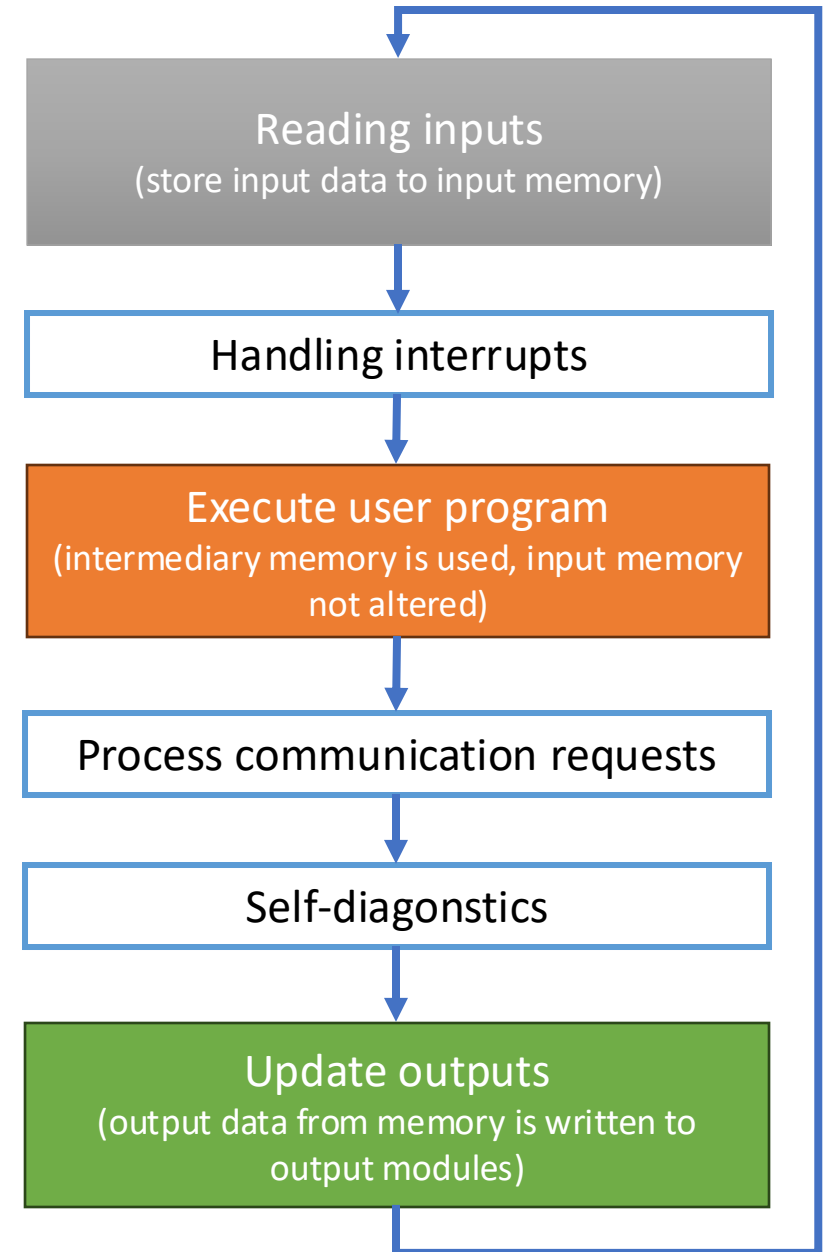

PLC memory organization



- Data Memory:
 - Purpose: For storing the operating system and user program.
 - Types:
 - Dynamic (RAM)
 - Non-volatile (Flash, EPROM, SD cards)
- Working Memory:
 - Purpose: Used for executing the program (intermediate memory image).
 - Type:
 - Dynamic (RAM)
- System Memory:
 - Purpose: For storing the processor state, including:
 - Input image, output image, bit memory, timers, counters
 - Stack of local function data
 - Block stack
 - Interrupt stack
 - Diagnostic memory
 - Type:
 - Dynamic (RAM)

Beckhoff CX7000

- Arm[®] Cortex[®]-M7 single-core processor with 480 MHz
- Slot for a microSD card and an Ethernet interface
- eight integrated multi-functional inputs
- four integrated multi-functional outputs
- does not have a fieldbus interface
- the control system is programmed with TwinCAT 3 via the Ethernet interface.



Beckhoff CX7000 – lab config schematic

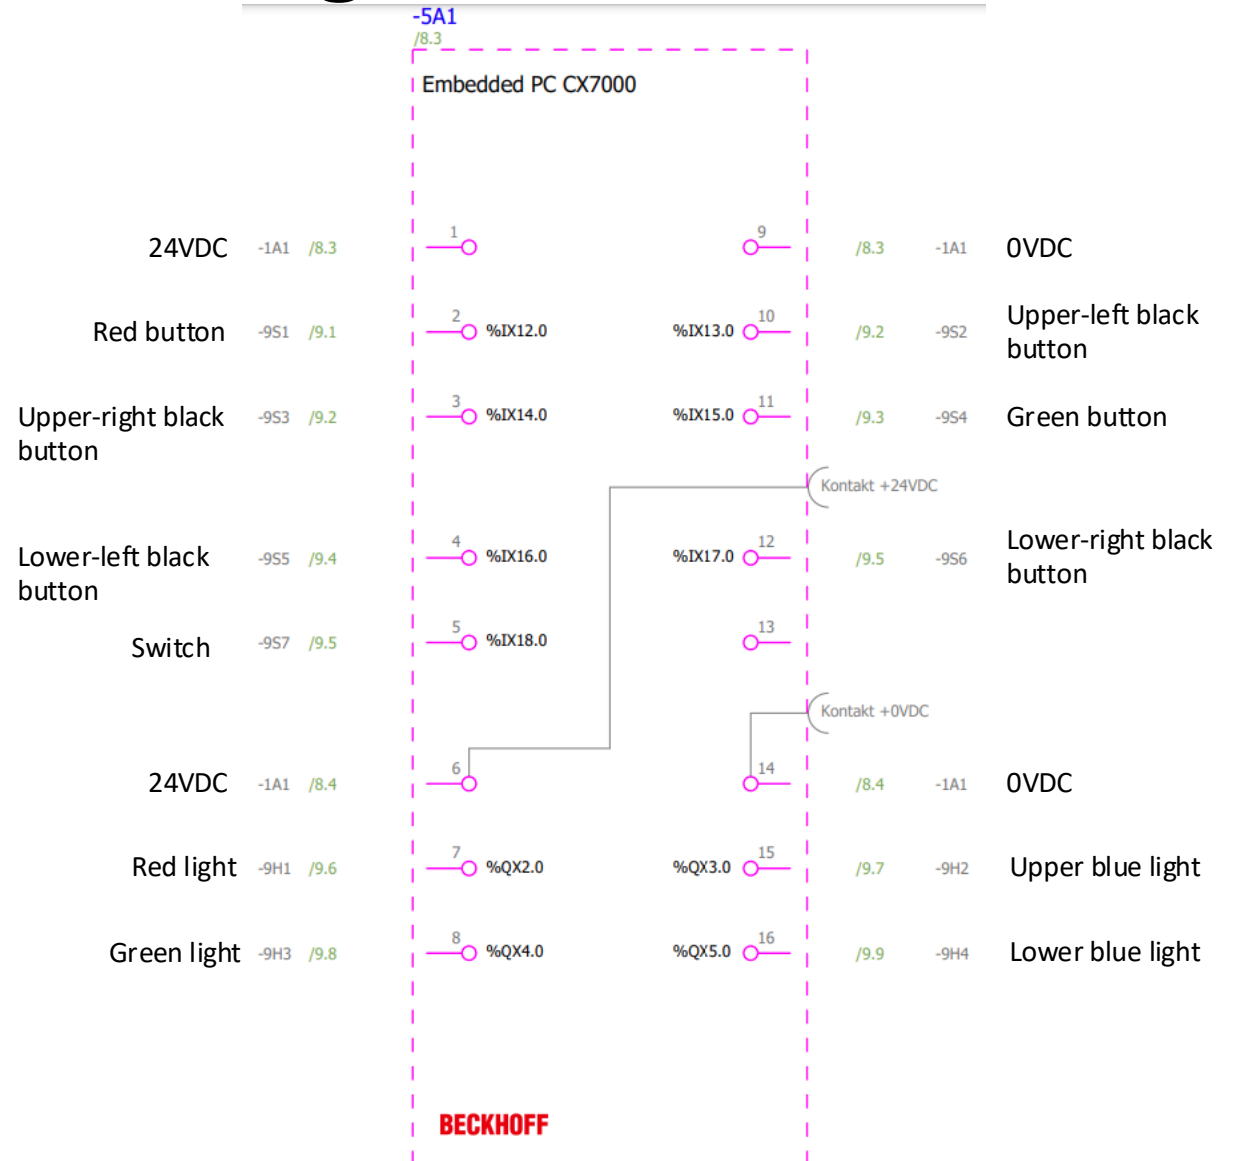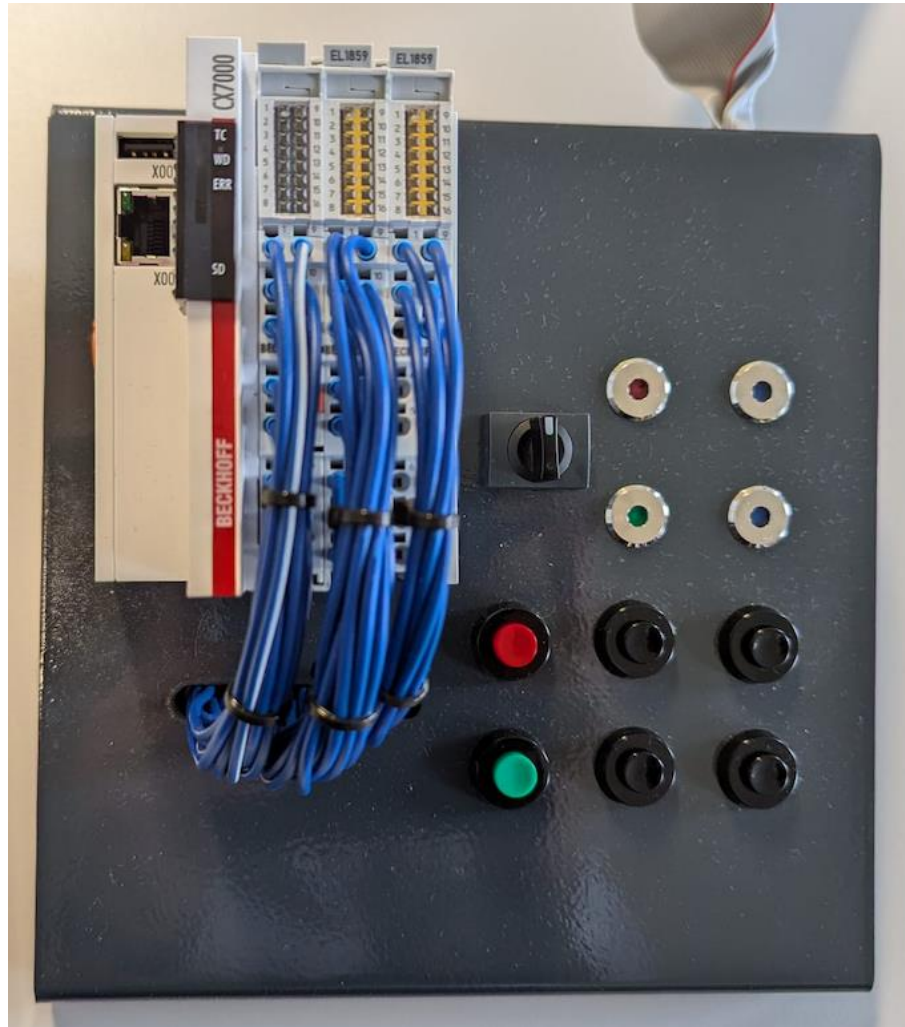

Process automation

Programmable Logic Controllers (PLCs)

- the hardware -

BS UNI studies, Fall semester 2024/2025

Octavian M. Machidon
octavian.machidon@fri.uni-lj.si